

Help for the Model Calculation Add-in for use in Excel

By T2E3, Inc.
Copyright © 2015

Help File Contents:

Getting Started

Installation

Making the Add-in available in Excel

Using Functions

Units on Function Inputs

Errors and Bad Values

Available Functions

Detailed Function Descriptions

gas_PTC22:	Natural gas properties based on methods given in ASME PTC 22
gas_AGA8:	Natural gas properties based on methods given in AGA Report No. 8
gas_Flow_Orifice:	Natural gas mass flow rate calculations for an orifice meter
gasEnthalpy:	Enthalpy of gas turbine exhaust gases
Air_DBPTRH:	Air properties given dry bulb temperature, barometric pressure and relative humidity
Air_DBPTWB:	Air properties given dry bulb temperature, barometric pressure and wet bulb temperature
Air_DBPTSH:	Air properties given dry bulb temperature, barometric pressure and specific humidity
Relhumidity:	Humidity of ambient air given dry bulb temperature and dew point
Barometer_psia:	Station barometric pressure given elevation
Elevation_ft:	Elevation corresponding to station elevation
StationPressure_psia:	Station barometric pressure given as-reported sea-level pressure, local elevation and dry bulb temperature
SealevelPressure_psia:	Equivalent sea-level barometric pressure given station barometric pressure, elevation and dry bulb temperature
CurveFit:	Y-value given polynomial curve coefficients
Interp:	Interpolation result for a set of data points
PowerFactor:	Electrical Power Factor
TotalVars:	Total Reactive Power Flow
EvapEff:	Evaporative cooling efficiency

expectedCIT:	Expected compressor inlet temperature downstream of an evaporative cooler
Comp_Eff:	Axial compressor efficiency
zAir:	Compressibility factor of air
Tsat_P:	Saturation temperature of water given pressure
Psat_T:	Saturation pressure of water given temperature
hV_P:	Enthalpy of saturated water vapor given pressure
hL_P:	Enthalpy of saturated liquid water given pressure
hV_T:	Enthalpy of saturated water vapor given temperature
hL_T:	Enthalpy of saturated liquid water given temperature
h_PT:	Enthalpy of water given pressure and temperature
h_Ps:	Enthalpy of water given pressure and entropy
h_Px:	Enthalpy of a water/steam mixture given pressure and quality
h_Tx:	Enthalpy of a water/steam mixture given temperature and quality
vV_P:	Specific volume of saturated water vapor given pressure
vL_P:	Specific volume of saturated liquid water given pressure
vV_T:	Specific volume of saturated water vapor given temperature
vL_T:	Specific volume of saturated liquid water given temperature
v_PT:	Specific volume of water given pressure and temperature
rhoV_P:	Density of saturated water vapor given pressure
rhoL_P:	Density of saturated liquid water given pressure
rhoV_T:	Density of saturated water vapor given temperature
rhoL_T:	Density of saturated liquid water given temperature
rho_PT:	Density of water given pressure and temperature
sV_P:	Entropy of saturated water vapor given pressure
sL_P:	Entropy of saturated liquid water given pressure
sV_T:	Entropy of saturated water vapor given temperature
sL_T:	Entropy of saturated liquid water given temperature
s_PT:	Entropy of water given pressure and temperature
s_Ph:	Entropy of water given pressure and enthalpy
Cp_PT:	Isobaric specific heat of water given pressure and temperature
Cv_PT:	Isochoric specific heat of water given pressure and temperature
visc_PT:	Dynamic viscosity of water given pressure and temperature

cond_PT:

Thermal conductivity of water given pressure and temperature

qual_Ph:

Quality of a water/steam mixture given pressure and enthalpy

qual_Ps:

Quality of a water/steam mixture given pressure and entropy

Contact T2E3, Inc.

Getting Started

Congratulations! You now have in your possession a program which will help you analyze your plant and equipment using custom functions in Excel. We hope you are able to put these functions to use in analyzing and improving the performance, reliability and profitability of your operations.

Installation

To install the add-in, you have been provided with a number of files on an installation CD or ZIP file. Copy these files to your local hard drive. The recommended location is:

C:\T2E3

The files copied should include:


- **T2E3 License.htm** – Please open and read this file, it contains the license agreement, including terms and conditions that you agree to by installing and using the T2E3 Add-in.
- **T2E3_Model.dll** – the add-in library file itself, two versions are included in the 32\ and 64\ sub-folders.
- **T2E3_XLL Samples.xlsx**– an Excel workbook with examples of all the included add-in functions.
- **T2E3_XLL_Help.PDF**– This help file.
- **T2E3install.exe** – the executable file which will walk you through the installation process.

Once the files are on your local hard drive, run the program “**T2E3install.exe**” by right-clicking on it and selecting “**Run As Administrator**”. This provides access to the license agreement, help file, and registration program. The add-in must be registered with the operating system before it will be visible in Excel. Registering the add-in requires access to the system registry, which is why the install program must be run ‘as administrator’.

When the registration is complete, you should get a message box like the one at right ->

If you do not see this message, the add-in was not completely installed. Please contact T2E3 for support with your installation.

If you do not know which version of Office you have, you can run the install program on any combination of OS and Excel version. It will not cause harm to your system. If you think you are seeing something unusual, contact T2E3 for support.

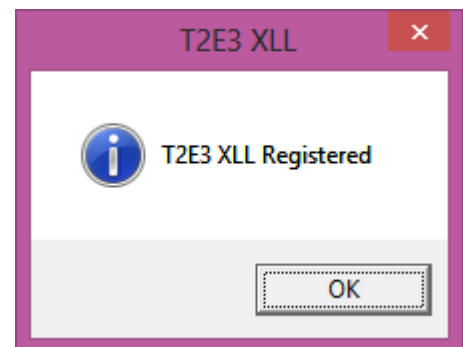

[Back to the Top](#)

Making the Add-in available in Excel

Once the Add-in has been successfully registered with the operating system, you must add the Add-in to the Excel list of available Add-ins.

Office 2007 and newer

From within Excel, select “**Excel Options**” from the main button menu (top left of the application window). Select “**Add-ins**” from the menu list on the left of the window that opens. At the bottom of that window, select “**Excel Add-ins**” in the drop-down box next to “**Manage**” and then click on “**Go...**”

... continued below

Office 2003 and older


From within Excel (with any workbook open), select “**Add-ins...**” from the “**Tools**” menu.

... continued below


For both versions of Office:

If you do not see “**T2E3.Model**” on the available Add-ins list, you will need to click on the “**Automation...**” button and find “**T2E3.Model**” in the list. To find it faster within the list, type a “T”, which will bring you down to the items beginning with the letter “T” in the list.

T2E3.Model should be one of the first “T”s shown.

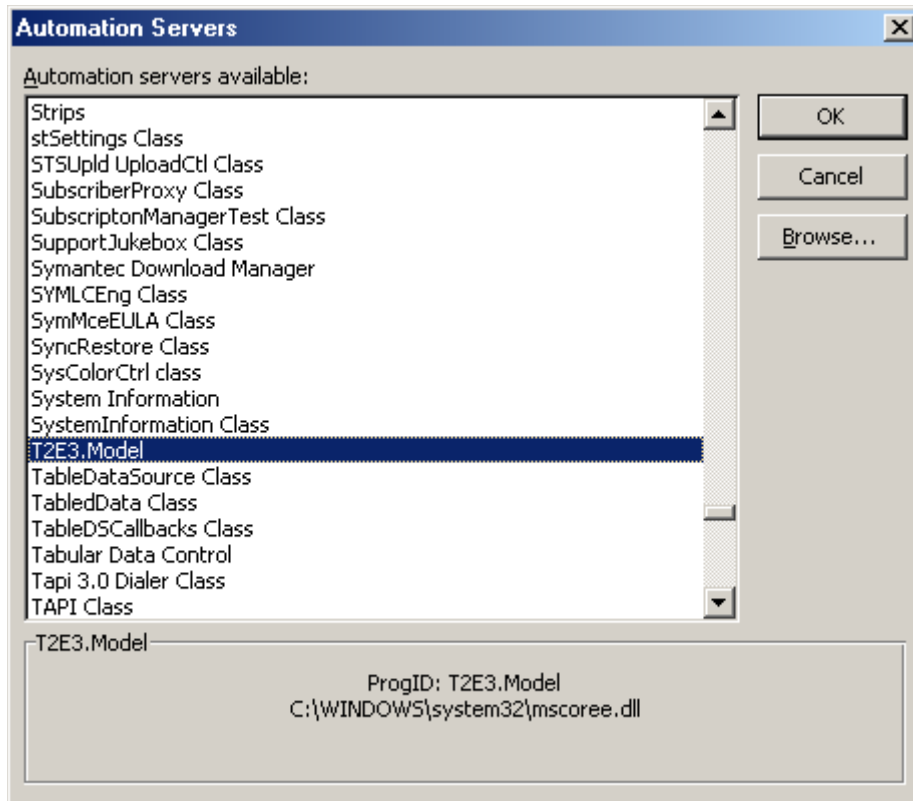

Click on “**T2E3.Model**” and select OK to place the Add-in in the available add-in list. The list should now look similar to the following:

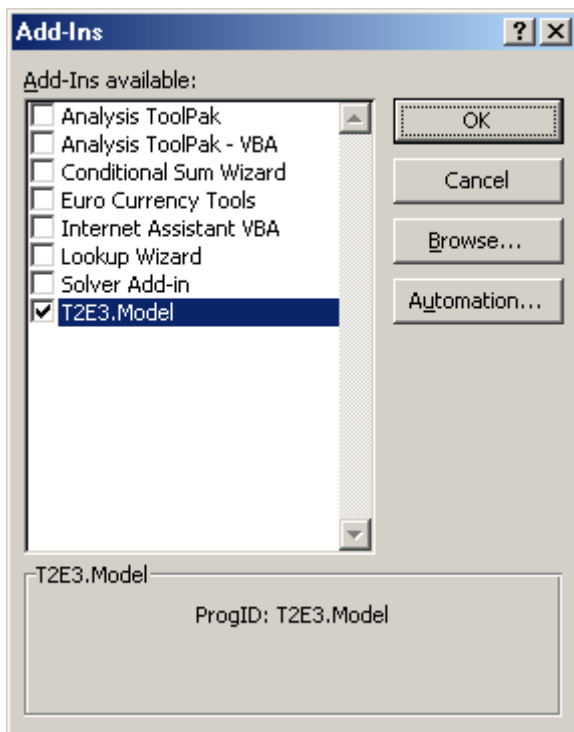


Then click “OK” to close out of the Add-in dialog box.

If you do not see T2E3.Model in the list of available Automation Add-ins, the DLL has not been successfully registered with the operating system. Rerun Step 2 from the T2E3install.exe program, above. If that does not correct the problem, [contact T2E3](#) for additional support.


[Back to the Top](#)

Using Functions


When using a function for the first time, it is recommended that you access the function from the “Function” item on the “Insert” menu within Excel. This will bring up the following dialog box:

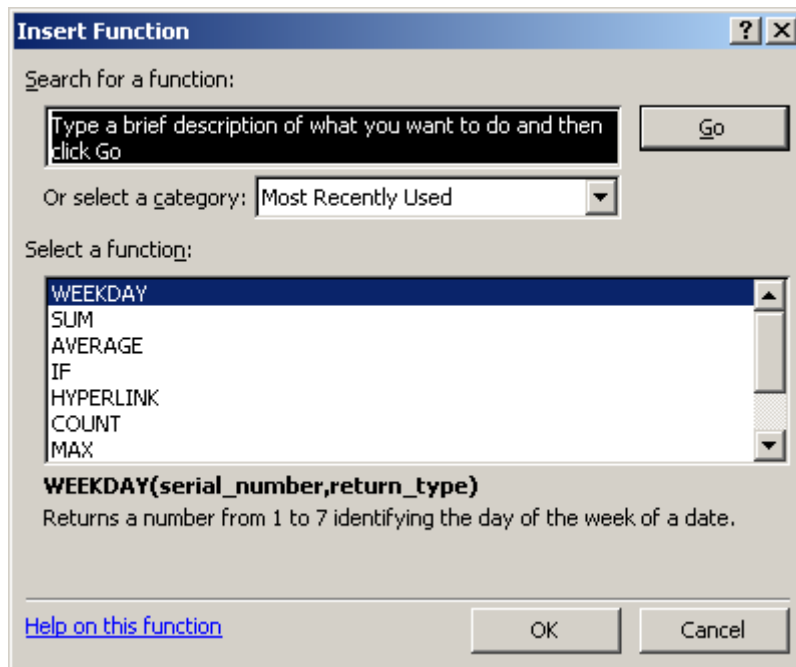


To find the functions available within the T2E3 Add-in, scroll down in the Category list and select “T2E3.Model”.

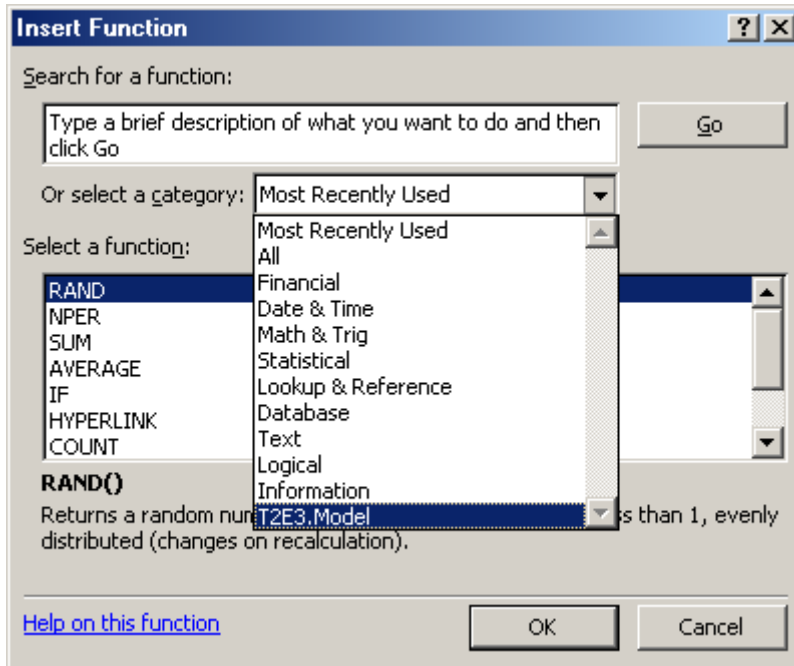

The functions available will now be shown in the box under “Select a function”. Select the desired function and click on OK. This will bring up a dialog box which will guide you through the required inputs for the function. For the example below, the function “Air_DBPTRH” was selected, which is a function which returns selected properties of moist air. (See below for a list of the specific functions available.)

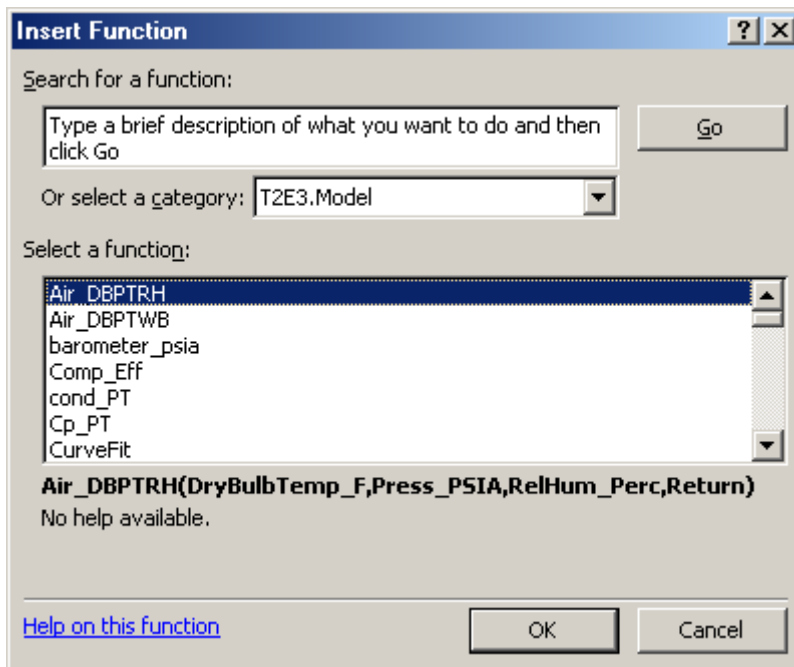

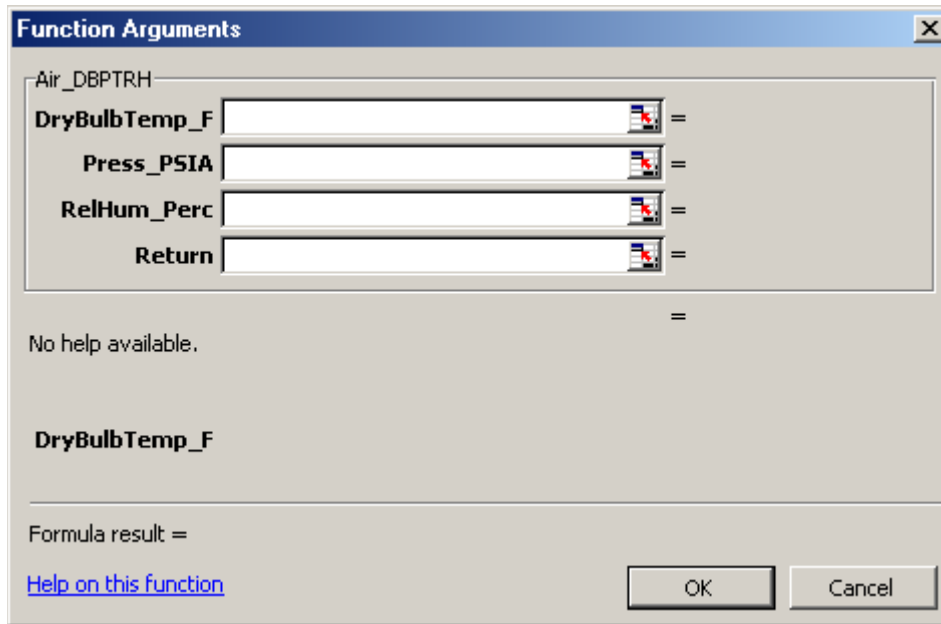

At this time, the only location for help on the functions is within this help file.

[Back to the Top](#)

Units on Function Inputs

Each function accepts inputs in a single set of units. Currently, this is based on the English set of units:

Pressure: PSIA (pounds per square inch – absolute. *Not gauge pressure*)

Temperature: Deg F

Differential Pressure: inH2O (inches of Water column)

Enthalpy: Btu/lb

Entropy: Btu/lb-F

Pipe and Orifice diameters: inches

Note: if you only measure pressures in gauge pressure, and do not have a measured value for station barometric pressure, add the design station barometric pressure to convert from gauge to absolute. If you do not have a design barometric pressure value to use, a base reference value of 14.7 psia can be used for reference barometric pressure.

$$\text{Value (PSIA)} = \text{Value (PSIG)} + \text{Design Barometric Pressure (PSIA)}$$

For example, if you measured 50 PSIG on a water system, and your design station barometric pressure value is 14.55 PSIA, the value for pressure you would enter into the steam property functions would be 64.55 PSIA:

$$64.55 \text{ PSIA} = 50 \text{ PSIG} + 14.55 \text{ PSIA}$$

[Back to the Top](#)

Errors and Bad Values

If the inputs are such that the function cannot complete a calculation, due to divide by zero, out of range input, or other error, the function will return a large negative integer value, such as “-999” to the user. Note that any large negative value may result, due to unit conversions within the function and/or your spreadsheet.

If you are getting a “-999” return when you do not think you should be, [contact T2E3](#) for additional support.

[Back to the Top](#)

Available Functions

The following functions are currently available in the Add-in. If you are looking for a function which is not listed, contact T2E3 support (support@t2e3.com) and request that the function be added. Functions are added on an as needed basis, based on the perceived value and number of requests received.

The following performance functions are included in this version of T2E3.Model:

- [gas PTC22](#) – natural gas properties, calculated based on information and methods found in PTC-22
- [gas AGA8](#) – natural gas properties based on American Gas Association (AGA) Report No. 8
- [gas Flow Orifice](#) – natural gas flow calculations for orifice meters, calculated based on information and methods found in PTC-19.5
- [gasEnthalpy](#) – enthalpy of gas turbine exhaust gases at either inlet or exhaust temperature
- [Air DBPTRH](#) – air properties, given Dry Bulb temperature, Pressure and Relative Humidity, based on ASHRAE standard 41.6 (RA 2006)
- [Air DBPTWB](#) – air properties, given Dry Bulb temperature, Pressure and Wet Bulb temperature, based on ASHRAE standard 41.6 (RA 2006)
- [Relhumidityt](#) – air relative humidity, given Dry Bulb temperature and Dew Point temperature
- [Barometer psia](#) – station barometric pressure, given station elevation
- [Elevation ft](#) – station elevation, given station barometric pressure
- [StationPressure psia](#) – station barometric pressure, given corresponding sea-level pressure (as reported at most airports)

- [SealevelPressure psia](#) – sea-level pressure (as reported at most airports), given station barometric pressure
- [CurveFit](#) – returns the y-value for a polynomial curve given the x-value and curve coefficients
- [Interpolate](#) – returns the y-value for a corresponding x-value, give a set of up to 5 pairs of values
- [EvapEff](#) – returns the evaporative cooler effectiveness, given dry bulb temperature, wet bulb temperature and compressor inlet temperature
- [expectedCIT](#) – returns the expected compressor inlet temperature, give dry bulb temperature, wet bulb temperature and evaporative cooler effectiveness
- [Comp Eff](#) – returns the compressor efficiency (either isentropic process, adiabatic work or polytropic work) given the compressor inlet and discharge pressures and temperatures

[Back to the Top](#)

The following IAPWS IF-97 steam and water property functions are included in this version of T2E3.Model:

Note: The function names for steam and water properties follow the following convention: return value first, followed by indication of Vapor or Liquid (if required), next comes an underscore, ‘_’, followed by the required inputs to the function:

P for Pressure, PSIA

T for Temperature, Deg F

h for enthalpy, Btu/lb

s for entropy, Btu/lb-F

x for quality, or vapor fraction

- [Tsat P](#) – saturation Temperature of steam, given Pressure
- [Psat T](#) – saturation Pressure of steam, given Temperature
- [hV P](#) – enthalpy of saturated water vapor, given Pressure
- [hL P](#) – enthalpy of saturated liquid water, given Pressure
- [hV T](#) – enthalpy of saturated water vapor, given Temperature
- [hL T](#) – enthalpy of saturated liquid water, given Temperature
- [h PT](#) – enthalpy of water or steam, given Pressure and Temperature
- [h Ps](#) – enthalpy of water or steam, given Pressure and entropy
- [h Px](#) – enthalpy of water or steam, given Pressure and quality (vapor fraction)
- [h Tx](#) – enthalpy of water or steam, given Temperature and quality (vapor fraction)
- [vV P](#) – specific volume of saturated water vapor, given Pressure
- [vL P](#) – specific volume of saturated liquid water, given Pressure
- [vV T](#) – specific volume of saturated water vapor, given Temperature
- [vL T](#) – specific volume of saturated liquid water, given Temperature
- [v PT](#) – specific volume of water or steam, given Pressure and Temperature

- [rhoV P](#) – density of saturated water vapor, given Pressure
- [rhoL P](#) – density of saturated liquid water, given Pressure
- [rhoV T](#) – density of saturated water vapor, given Temperature
- [rhoL T](#) – density of saturated liquid water, given Temperature
- [rho PT](#) – density of water or steam, given Pressure and Temperature
- [sV P](#) – entropy of saturated water vapor, given Pressure
- [sL P](#) – entropy of saturated liquid water, given Pressure
- [sV T](#) – entropy of saturated water vapor, given Temperature
- [sL T](#) – entropy of saturated liquid water, given Temperature
- [s PT](#) – entropy of water or steam, given Pressure and Temperature
- [s Ph](#) – entropy of water or steam, given Pressure and enthalpy
- [Cp PT](#) – specific heat (at constant pressure) of water or steam, given Pressure and Temperature
- [Cv PT](#) – specific heat (at constant volume) of water or steam, given Pressure and Temperature
- [visc PT](#) – viscosity of water or steam, given Pressure and Temperature
- [cond PT](#) – conductivity of water or steam, given Pressure and Temperature
- [qual Ph](#) – quality (vapor fraction) of water & steam mixture, given Pressure and enthalpy
- [qual Ps](#) – quality (vapor fraction) of water & steam mixture, given Pressure and entropy

[Back to the Top](#)

Detailed Function Descriptions

gas_PTC22:
given in ASME PTC 22

Natural gas properties based on methods

Returns: The selected property for a natural gas mixture, based on the value of “Return”, as shown below.

Required Inputs:

- xMethane** – molar percent of methane (CH₄) in gas mixture
- xNitrogen** – molar percent of nitrogen (N₂) in gas mixture
- xCO₂** – molar percent of carbon dioxide (CO₂) in gas mixture
- xEthane** – molar percent of ethane (C₂H₆) in gas mixture
- xPropane** – molar percent of propane (C₃H₈) in gas mixture
- xWater** – molar percent of water (H₂O) in gas mixture
- xH₂S** – molar percent of hydrogen sulfide (H₂S) in gas mixture
- xHydrogen** – molar percent of hydrogen (H₂) in gas mixture
- xCO** – molar percent of carbon monoxide (CO) in gas mixture
- xOxygen** – molar percent of oxygen (O₂) in gas mixture

xiButane – molar percent of isoButane (C₄H₁₀) in gas mixture
xnButane – molar percent of n-Butane (C₄H₁₀) in gas mixture
xiPentane – molar percent of isoPentane (C₅H₁₂) in gas mixture
xnPentane – molar percent of n-Pentane (C₅H₁₀) in gas mixture
xHexane – molar percent of hexane (C₆H₁₄) in gas mixture
xHeptane – molar percent of heptane (C₇H₁₆) in gas mixture
xOctane – molar percent of octane (C₈H₁₈) in gas mixture
xNonane – molar percent of nonane (C₉H₂₀) in gas mixture
xDecane – molar percent of decane (C₁₀H₂₂) in gas mixture
xHelium – molar percent of helium (He) in gas mixture
xArgon – molar percent of argon (Ar) in gas mixture

Return – desired return value from the function, selected from the following:

- “**HHV**” - gas mixture higher heating value, Btu/lb
- “**LHV**” - gas mixture lower heating value, Btu/lb
- “**SD**” - gas mixture density at standard conditions (14.696 psia & 60.0 Deg F), lb/ft³
- “**MW**” - molecular weight of gas mixture, lb/lbmol
- “**VS**” - dynamic viscosity of gas mixture, lbm/ft-s
- “**CP**” – specific heat at constant pressure of gas mixture, Btu/lbm-F
- “**CHM**” - carbon-hydrogen ratio of gas mixture, by mol; molC/molH
- “**CHW**” - carbon-hydrogen ratio of gas mixture, by weight; lbC/lbH
- “**SG**” – specific gravity of the mixture, relative to air
- “**WI**” – Wobbe index of the mixture, Btu/SCF

Limitations and Assumptions:

- Values are based on Table 4-4.5 of PTC-22 (2005). Referenced to 60.0F and 14.696 psia.
- Air standard density is equal to 0.76328 lbm/ft³

References: ASME PTC 22 (2005)

[Back to Function Listing](#)

[Back to the Top](#)

gas_AGA8: Natural gas properties based on methods given in AGA Report No. 8

Returns: The selected property for a natural gas mixture, based on the value of “Return”, as shown below.

Required Inputs:

Pin – Pressure of gas mixture, PSIA
Tin – Temperature of gas mixture, Deg F
xMethane – molar percent of methane (CH₄) in gas mixture
xNitrogen – molar percent of nitrogen (N₂) in gas mixture
xCO₂ – molar percent of carbon dioxide (CO₂) in gas mixture
xEthane – molar percent of ethane (C₂H₆) in gas mixture

xPropane – molar percent of propane (C₃H₈) in gas mixture
xWater – molar percent of water (H₂O) in gas mixture
xH₂S – molar percent of hydrogen sulfide (H₂S) in gas mixture
xHydrogen – molar percent of hydrogen (H₂) in gas mixture
xCO – molar percent of carbon monoxide (CO) in gas mixture
xOxygen – molar percent of oxygen (O₂) in gas mixture
xiButane – molar percent of isoButane (C₄H₁₀) in gas mixture
xnButane – molar percent of n-Butane (C₄H₁₀) in gas mixture
xiPentane – molar percent of isoPentane (C₅H₁₂) in gas mixture
xnPentane – molar percent of n-Pentane (C₅H₁₀) in gas mixture
xHexane – molar percent of hexane (C₆H₁₄) in gas mixture
xHeptane – molar percent of heptane (C₇H₁₆) in gas mixture
xOctane – molar percent of octane (C₈H₁₈) in gas mixture
xNonane – molar percent of nonane (C₉H₂₀) in gas mixture
xDecane – molar percent of decane (C₁₀H₂₂) in gas mixture
xHelium – molar percent of helium (He) in gas mixture
xArgon – molar percent of argon (Ar) in gas mixture
Return – desired return value from the function, selected from the following:
 “**SCFDENSITY**” - lb/scf at standard conditions
 “**ACFDENSITY**” - lb/acf at flowing conditions
 “**Z**” - Compressibility at flowing conditions
 “**FPV**” - Ratio of compressibility at flowing versus standard conditions

Limitations and Assumptions:

- Values are based on AGA Report NO. 8. Referenced to 60.0F and 14.73 psia.

References: AGA Report No. 8, 1994

[Back to Function Listing](#)

[Back to the Top](#)

*gas_Flow_Orifice:
calculations for an orifice meter*

Natural gas mass flow rate

Returns: The selected flow calculation result for a orifice meter with natural gas as the flowing fluid, based on the value of “Return”, as shown below.

Required Inputs:

Pflow – Flowing pressure (upstream), PSIA
Tflow – Flowing temperature (upstream), Deg F
DP - Differential Pressure across Orifice meter, in H₂O
OrificeDiam - Diameter of the orifice bore, inches
PipeDiam - Diameter of the pipe, inches
Omaterial - orifice material, SS (stainless steel 300 series) or CS (carbon steel)
Pmaterial - pipe material, SS (stainless steel 300 series) or CS (carbon steel)

Cd - discharge coefficient, if less than 0.5, will be calculated

Cp - specific heat of gas mixture; Btu/lb-R

MW - molecular weight of gas mixture; lb/lbmol

density - upstream flowing density of gas mixture; lb/ft³

viscosity - upstream flowing dynamic viscosity of gas mixture; lb/ft-s

Return – desired return value from the function, selected from the following:

“**PPH**” – calculated flow rate in pounds per hour (lb/hr or PPH)

“**Re**” - Reynolds number

“**Cd**” - calculated discharge coefficient

“**Beta**” - beta ratio at flowing conditions

Limitations and Assumptions:

- Values are based on method outlined in ASME PTC 19.5.
- Pipe and orifice diameters measurements provided to the function are at a reference temperature of 68°F.

References: ASME PTC 19.5 (2004)

[Back to Function Listing](#)

[Back to the Top](#)

gasEnthalpy:

Enthalpy of gas turbine exhaust gases

Returns: The enthalpy of gas turbine exhaust gases, in Btu/lb.

Required Inputs:

GTfuel_KSCFH – gas turbine fuel flow (natural gas only), in standard cubic feet per hour x 1000 (KSCFH)

airflow_KPPH – air flow through gas turbine compressor, in standard cubic feet per hour x 1000 (KSCFH)

injflow_KPPH – water injection flow into compressor and/or combustion chamber, pounds per hour x 1000 (KPPH)

DryBulbTemp_DegF – ambient dry bulb temperature, Deg F

CIT_DegF – compressor inlet temperature, Deg F

WetBulbTemp_DegF – ambient wet bulb temperature, Deg F

Press_PsIA – absolute station barometric pressure, PSIA

ExhaustTemp_DegF – temperature of exhaust gases, Deg F

xMethane – molar percent of methane (CH₄) in gas mixture

xEthane – molar percent of ethane (C₂H₆) in gas mixture

xPropane – molar percent of propane (C₃H₈) in gas mixture

xiButane – molar percent of isoButane (C₄H₁₀) in gas mixture

xnButane – molar percent of n-Butane (C₄H₁₀) in gas mixture

xiPentane – molar percent of isoPentane (C₅H₁₂) in gas mixture

xnPentane – molar percent of n-Pentane (C₅H₁₀) in gas mixture

xHexane – molar percent of hexane (C₆H₁₄) in gas mixture

xHeptane – molar percent of heptane (C7H16) in gas mixture
xOctane – molar percent of octane (C8H18) in gas mixture
xCO2 – molar percent of carbon dioxide (CO2) in gas mixture
xNitrogen – molar percent of nitrogen (N2) in gas mixture
xOxygen – molar percent of oxygen (O2) in gas mixture
xHelium – molar percent of helium (He) in gas mixture
xHydrogen – molar percent of hydrogen (H2) in gas mixture

References: ASME PTC 4.4

[Back to Function Listing](#)

[Back to the Top](#)

Air_DBPTRH: Air properties given dry bulb temperature, barometric pressure and relative humidity

Returns: The selected air property, based on the value of “Return”, as shown below.

Required Inputs:

DryBulbTemp_F – dry bulb temperature of the air, Deg F
Press_PSIA – absolute pressure of the air, PSIA
RelHum_Perc – relative humidity of the air, in percent (%)

Return – desired return value from the function, selected from the following:

“**TWB**” - air wet bulb temperature, Deg F
“**SH**” - specific humidity (aka humidity ratio) of the air, lb-water/lb-dry-air
“**TDP**” - dew point temperature of the air, Deg F
“**DS**” - degree of saturation, ratio
“**SV**” – specific volume of the moist air, ft³/lb
“**PW**” – vapor pressure of the air, PSIA
“**PWS**” – saturated vapor pressure of the air, PSIA
“**H**” – enthalpy of the moist air, btu/lb

References: ANSI/ASHRAE Standard 41.6-1994 (RA 2006)

[Back to Function Listing](#)

[Back to the Top](#)

Air_DBPTWB: Air properties given dry bulb temperature, barometric pressure and wet bulb temperature

Returns: The selected air property, based on the value of “Return”, as shown below.

Required Inputs:

DryBulbTemp_F – dry bulb temperature of the air, Deg F
Press_PSIA – absolute pressure of the air, PSIA
WetBulbTemp_F – wet bulb temperature of the air, Deg F

Return – desired return value from the function, selected from the following:

“**RH**” – relative humidity of the air in percent, %
“**SH**” – specific humidity (aka humidity ratio) of the air, lb-water/lb-dry-air
“**TDP**” – dew point temperature of the air, Deg F
“**DS**” – degree of saturation, ratio
“**SV**” – specific volume of the moist air, ft³/lb
“**PW**” – vapor pressure of the air, PSIA
“**PWS**” – saturated vapor pressure of the air, PSIA
“**H**” – enthalpy of the moist air, btu/lb

References: ANSI/ASHRAE Standard 41.6-1994 (RA 2006)

[Back to Function Listing](#)

[Back to the Top](#)

Air_DBPTSH: Air properties given dry bulb temperature, barometric pressure and specific humidity

Returns: The selected air property, based on the value of “Return”, as shown below.

Required Inputs:

DryBulbTemp_F – dry bulb temperature of the air, Deg F
Press_PSIA – absolute pressure of the air, PSIA
SpecHum_lblb – specific humidity (aka humidity ratio) of the air, lb-water/lb-dry-air

Return – desired return value from the function, selected from the following:

“**RH**” – relative humidity of the air in percent, %
“**TWB**” – air wet bulb temperature, Deg F
“**TDP**” – dew point temperature of the air, Deg F
“**DS**” – degree of saturation, ratio
“**SV**” – specific volume of the moist air, ft³/lb
“**PW**” – vapor pressure of the air, PSIA
“**PWS**” – saturated vapor pressure of the air, PSIA
“**H**” – enthalpy of the moist air, btu/lb

References: ANSI/ASHRAE Standard 41.6-1994 (RA 2006)

[Back to Function Listing](#)

[Back to the Top](#)

Relhumidity: *Humidity of ambient air given dry bulb temperature and dew point*

Returns: An estimate of the relative humidity of the air.

Required Inputs:

Tdrybulb_DegF – dry bulb temperature of the air, Deg F

Tdewpt_DegF – dew point temperature of the air, Deg F

Limitations and Assumptions:

- Good for dry bulb temperatures between 32 F and 199.4 F.

References: ANSI/ASHRAE Standard 41.6-1994 (RA 2006)

[Back to Function Listing](#)

[Back to the Top](#)

Barometer_psia: *Station barometric pressure given elevation*

Returns: Station barometric pressure, PSIA, based on standard atmosphere and normal sea-level pressure of 14.696 PSIA.

Required Inputs:

Elevation_ft – station elevation, ft

References: N/A

[Back to Function Listing](#)

[Back to the Top](#)

Elevation_ft: *Elevation corresponding to station elevation*

Returns: Station elevation, ft, based on standard atmosphere and normal sea-level pressure of 14.696 PSIA.

Required Inputs:

Barometer_psia – station barometric pressure, PSIA

References: N/A

[Back to Function Listing](#)

[Back to the Top](#)

StationPressure_psia: Station barometric pressure given as-reported sea-level pressure, local elevation and dry bulb temperature

Returns: Station pressure, PSIA, based on standard atmosphere and as-reported sea-level pressure.

Required Inputs:

sealevelpress_psia – reported local sea-level pressure (i.e. from local airport), PSIA

elevation_ft – local elevation, ft

Tdb_DegF – ambient dry bulb temperature, Deg F

References: N/A

[Back to Function Listing](#)

[Back to the Top](#)

SealevelPressure_psia: Equivalent sea-level barometric pressure given station barometric pressure, elevation and dry bulb temperature

Returns: Station pressure corrected to sea-level (i.e. as may be reported at local airports), PSIA, based on standard atmosphere.

Required Inputs:

stationpress_psia – station barometric pressure, PSIA

elevation_ft – local elevation, ft

Tdb_DegF – ambient dry bulb temperature, Deg F

References: N/A

[Back to Function Listing](#)

[Back to the Top](#)

CurveFit:

Y-value given polynomial curve coefficients

Returns: y-value of polynomial curve

Required Inputs:

- X** – x-value on curve which corresponds to the desired y-value
- A0** – polynomial curve coefficient for x^0 (the constant value)
- A1** – polynomial curve coefficient for x^1 (x)
- A2** – polynomial curve coefficient for x^2
- A3** – polynomial curve coefficient for x^3
- A4** – polynomial curve coefficient for x^4
- A5** – polynomial curve coefficient for x^5
- A6** – polynomial curve coefficient for x^6

References: N/A

[Back to Function Listing](#)

[Back to the Top](#)

Interp:

Interpolation result for a set of data points

Returns: y-value which corresponds to the given x-value using a straight line interpolation between the two closest values in the given value pairs.

Required Inputs:

- x** – x-value for which the corresponding y-value is desired
- x1, y1** – first pair of values; the one with the lowest value of x
- x2, y2** – second pair of values
- x3, y3** – third pair of values
- x4, y4** – fourth pair of values
- x5, y5** – fifth pair of values
- x6, y6** – sixth pair of values
- n** – the number of pairs to use in the calculation

Limitations and Assumptions:

- All inputs are required. The first 'n' number of pairs are used in the calculation. For pairs above 'n' which are not used, any value can be used as a placeholder (i.e. 0,0).
- The pairs of values must be ordered such that the following is true:
 $x0 < x1 < x2 < x3 < x4 < x5$

References: N/A

[Back to Function Listing](#)

[Back to the Top](#)

PowerFactor:

Electrical Power Factor

Returns: The calculated power factor at the given point

Required Inputs:

kW – total real power at that point, kW

kVar – total reactive power at that point, kVar

References: N/A

[Back to Function Listing](#)

[Back to the Top](#)

TotalVars:

Total Reactive Power Flow

Returns: The calculated reactive power flow at the given point, kVar

Required Inputs:

kW – total real power at that point, kW

PF – power factor at that point

References: N/A

[Back to Function Listing](#)

[Back to the Top](#)

EvapEff:

Evaporative cooling efficiency

Returns: The effectiveness of an evaporative cooler, %

Required Inputs:

Tdb_DegF – ambient dry bulb temperature upstream of the cooler, Deg F

Twb_DegF – ambient wet bulb temperature upstream of the cooler, Deg F

CIT_DegF – dry bulb temperature downstream of the cooler (i.e. the compressor inlet temperature), Deg F

References: N/A

[Back to Function Listing](#)

[Back to Function Listing](#)
[Back to the Top](#)

hV_P: *Enthalpy of saturated water vapor given*
pressure

Returns: The enthalpy of saturated water vapor, Btu/lb.

Required Inputs:

Press_PSIA – pressure of the water in PSIA

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)
[Back to the Top](#)

hL_P: *Enthalpy of saturated liquid water given*
pressure

Returns: The enthalpy of saturated liquid water, Btu/lb.

Required Inputs:

Press_PSIA – pressure of the water in PSIA

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)
[Back to the Top](#)

hV_T:
temperature

Enthalpy of saturated water vapor given

Returns: The enthalpy of saturated water vapor, Btu/lb.

Required Inputs:

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

hL_T:
temperature

Enthalpy of saturated liquid water given

Returns: The enthalpy of saturated liquid water, Btu/lb.

Required Inputs:

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

h_PT:
temperature

Enthalpy of water given pressure and

Returns: The enthalpy of water or steam, Btu/lb.

Required Inputs:

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

h_{Tx} : Enthalpy of a water/steam mixture given temperature and quality

Returns: The enthalpy of water & steam mixture, Btu/lb.

Required Inputs:

Temp_DegF – temperature of water/steam mixture, Deg F

Quality_fraction – Quality (vapor fraction) of water/steam mixture as fraction

Limitations and Assumptions:

- Quality (vapor fraction) must be between zero (0) and one (1)

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

v_{V_P} : Specific volume of saturated water vapor given pressure

Returns: The specific volume of saturated water vapor, ft³/lb

Required Inputs:

Press_PsIA – pressure of the water in PSIA

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

vL_P: Specific volume of saturated liquid water given pressure

Returns: The specific volume of saturated liquid water, ft³/lb.

Required Inputs:

Press_PSIA – pressure of the water in PSIA

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

vV_T: Specific volume of saturated water vapor given temperature

Returns: The specific volume of saturated water vapor, ft³/lb.

Required Inputs:

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

vL_T: Specific volume of saturated liquid water given temperature

Returns: The specific volume of saturated liquid water, ft³/lb.

Required Inputs:

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

v_{PT}: *Specific volume of water given pressure and temperature*

Returns: The specific volume of water or steam, ft³/lb.

Required Inputs:

Press_PSIA – pressure of water in PSIA

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- none

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

rho V_P: *Density of saturated water vapor given pressure*

Returns: The density of saturated water vapor, lb/ft³.

Required Inputs:

Press_PSIA – pressure of the water in PSIA

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

rhoL_P: Density of saturated liquid water given pressure

Returns: The density of saturated liquid water, lb/ft³.

Required Inputs:

Press_PSIA – pressure of the water in PSIA

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

rhoV_T: Density of saturated water vapor given temperature

Returns: The density of saturated water vapor, lb/ft³.

Required Inputs:

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

rhoL_T:
temperature

Density of saturated liquid water given

Returns: The density of saturated liquid water, lb/ft³.

Required Inputs:

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

rho_PT:

Density of water given pressure and temperature

Returns: The density of water or steam, lb/ft³.

Required Inputs:

Press_PSIA – pressure of water in PSIA

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- none

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

sV_P:

Entropy of saturated water vapor given pressure

Returns: The entropy of saturated water vapor, Btu/lb-F.

Required Inputs:

Press_PSIA – pressure of the water in PSIA

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

sL_P: Entropy of saturated liquid water given pressure

Returns: The entropy of saturated liquid water, Btu/lb-F.

Required Inputs:

Press_PSIA – pressure of the water in PSIA

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

sV_T: Entropy of saturated water vapor given temperature

Returns: The entropy of saturated water vapor, Btu/lb-F.

Required Inputs:

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

s_{L_T}:
temperature

Entropy of saturated liquid water given

Returns: The entropy of saturated liquid water, Btu/lb-F.

Required Inputs:

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

s_{PT}:
temperature

Entropy of water given pressure and

Returns: The entropy of water or steam, Btu/lb-F.

Required Inputs:

Press_PsIA – pressure of water in PSIA

Temp_DegF - temperature of the water in Deg F

Limitations and Assumptions:

- none

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

s_{Ph}:

Entropy of water given pressure and enthalpy

Returns: The entropy of water or steam, Btu/lb-F.

- none

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

visc_PT:
temperature

Dynamic viscosity of water given pressure and

Returns: The dynamic viscosity of water or steam, lb/ft/hr.

Required Inputs:

Press_PSIA – pressure of water/steam in PSIA

Temp_DegF - temperature of water/steam in Deg F

Limitations and Assumptions:

- none

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)

[Back to the Top](#)

cond_PT:
and temperature

Thermal conductivity of water given pressure

Returns: The thermal conductivity of water or steam, Btu/(hr-ft-F)

Required Inputs:

Press_PSIA – pressure of water/steam in PSIA

Temp_DegF - temperature of water/steam in Deg F

Limitations and Assumptions:

- Temperature greater than 32 Deg F and less than 980 Deg F
- Pressure greater than 0.089 PSIA
- Certain regions are also not allowed, the function will return -999 when out of range

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)
[Back to the Top](#)

qual_Ph:
and enthalpy

Quality of a water/steam mixture given pressure

Returns: The quality (vapor fraction) of a water and steam mixture as a fraction (value between zero (0) and one (1)).

Required Inputs:

Press_PsIA – pressure of water/steam mixture in PSIA
enthalpy_btulb - enthalpy of the water/steam mixture in Btu/lb

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)
[Back to the Top](#)

qual_Ps:
and entropy

Quality of a water/steam mixture given pressure

Returns: The quality (vapor fraction) of a water and steam mixture as a fraction (value between zero (0) and one (1)).

Required Inputs:

Press_PsIA – pressure of water/steam mixture in PSIA
Entropy_btulbF - entropy of the water/steam mixture in Btu/lb-F

Limitations and Assumptions:

- This function is only value for pressures between 0.09 psia and 3200 psia.

References: IAPWS IF-97 (see www.iapws.org) based on code provided by Magnus Holmgren and www.x-eng.com.

[Back to Function Listing](#)
[Back to the Top](#)

Contact T2E3, Inc.

T2E3, Inc. can be contacted at the following:

Tina, L. Toburen, P.E.
support@t2e3.com
425-821-6036

14260 120th PL NE
Kirkland, WA 98034

[Back to the Top](#)